

USER'S REFERENCE MANUAL

RELAYIO-104

Relay Output / Isolated Input PC/104 Module

Model No. 100-7610

Doc. No. M7610

Rev: 1.3 6/15/06



649 School Street / Pembroke, MA 02359 USA / Tel: (781) 293-3059

www.scidyne.com

© Copyright 1999 - 2006
SCIDYNE
“All Rights Reserved”
Previous revision: 1.2 7/22/05

DISCLAIMER: This document contains proprietary information regarding SCIDYNE and its products. The information is subject to change without notice. SCIDYNE makes no warranty of any kind with regard to this material, including but not limited to, the implied warranties of merchantability and fitness for a particular purpose. SCIDYNE shall not be liable for errors contained herein or for incidental or consequential damages in connection with the furnishing, performance, or use of this material. No part of this document may be duplicated in any form without prior written consent of SCIDYNE.

WARRANTY: SCIDYNE warrants this product against defects in materials and workmanship and, that it shall conform to specifications current at the time of shipment, for a period of one year from date of shipment. Duration and conditions of warranty may be superseded when the product is integrated into other SCIDYNE products. During the warranty period, SCIDYNE will, at its option and without charge to Buyer, either repair or replace products which prove defective. Repair or replacement of a defective product or part thereof does not extend the original warranty period.

WARRANTY SERVICE: For warranty service or repair, this product must be returned to a service facility designated by SCIDYNE. The Buyer must obtain prior approval and a Return Material Authorization (RMA) number before returning any products. The RMA number must be clearly visible on the shipping container. The Buyer shall prepay shipping and insurance charges to the service facility and SCIDYNE shall pay shipping and insurance charges to

Buyer’s facility for products repaired or replaced. SCIDYNE may, at its discretion, bill the Buyer for return shipping and insurance charges for products received for repair but determined to be non-defective. Additionally, the Buyer shall pay all shipping charges, duties and taxes for products returned to SCIDYNE from another country.

LIMITATION OF WARRANTY: The forgoing warranty shall not apply to defects resulting from improper or negligent maintenance by the Buyer, Buyer-supplied products or interfacing, unauthorized modifications or misuse, operation outside the published specifications of the product or improper installation site preparation or maintenance, or the result of an accident. The design and implementation of any circuit using this product is the sole responsibility of the Buyer. SCIDYNE does not warrant the Buyer’s circuitry or malfunctions of SCIDYNE products that result from the Buyer’s circuitry. In addition, SCIDYNE does not warrant any damage that occurs as a result of the Buyer’s circuit or any defects that result from Buyer-supplied products. This Warranty does not cover normal preventative maintenance items such as fuse replacement, lamp replacement, resetting of circuit breakers, cleaning of the Product or problems caused by lack of preventative maintenance, improper cleaning, improper programming or improper operating procedures. No other warranty is expressed or implied. SCIDYNE specifically disclaims the implied warranties of merchantability and fitness for a particular purpose. Some states do not permit limitation or exclusion of implied warranties; therefore, the aforesaid limitation(s) or exclusion(s) may not apply to the Buyer. This warranty gives you specific legal rights and you may have other rights which vary from state to state.

CERTIFICATION: Testing and other quality control techniques are utilized to the extent SCIDYNE deems necessary to support this warranty. Specific testing of all parameters is not necessarily performed, except those mandated by government requirements.

30-DAY PRODUCT EVALUATION POLICY: SCIDYNE offers a no-risk trial for initial, low quantity, evaluation purchases. Items purchased for evaluation can be returned within 30 days for a full refund less shipping charges. The Buyer must obtain a Return Material Authorization (RMA) number before returning any products. The entire package, including hardware, software, documentation, discount coupons and any other accessories supplied must be returned intact and in new and working condition. This policy will not be honored for packages that are not returned complete and intact. The Buyer shall prepay shipping and insurance charges to SCIDYNE. To expedite the return process, the RMA number must be clearly visible on the shipping container. SCIDYNE will cancel the invoice, refund by check or issue credit to your credit card within 10 days after receipt of returned merchandise.

LIFE SUPPORT POLICY: Certain applications may involve the risks of death, personal injury or severe property or environmental damage (“Critical Applications”).


SCIDYNE products are not designed, intended, authorized or warranted to be suitable for use in life-support applications, devices or systems or other critical applications without the express written approval of the president of SCIDYNE.


Table of Contents


INTRODUCTION	2
Component Identification	2
MODULE SETUP	3
Setting the Module Base Address	3
Register Map	3
HARDWARE INTERFACE	4
General	4
J6, Input/Output Header Connections	4
Relay Outputs	5
DOUT_REG	5
Digital Inputs	6
DOUT_REG	6
AC Input Filters	7
INTERRUPTS	8
Host Interrupt Configuration	8
Interrupt Status Register	8
Interrupt Circuitry and Timing Sequence	9
SPECIFICATIONS	10

Conventions and Terminology Used Throughout This Publication

Safety and Usage Conventions

 NOTE: *Contains important information and useful tips that will assist in the understanding and operation of the product.*

 CAUTION: *Calls attention to a procedure, practice or condition that could possibly cause personal injury or damage to equipment.*

 WARNING: *Calls attention to a procedure, practice or condition that could possibly cause severe bodily injury, death or extensive equipment damage.*

Terminology

Host This is the computer or similar device into which the RELAYIO-104 is plugged.

Logic conditions Unless otherwise noted, logic signals are designated as TRUE (Set) and FALSE (Clear). Names with an asterisk (*) postscript are inverted or active low. Unless otherwise noted TRUE is considered logic “1” (+5vdc) and FALSE is logic “0” (0vdc).

Numbering Systems Computerized equipment often requires its numeric data to be represented in different forms depending on the audience and information being conveyed. Decimal numbers are typically used for end-user data entry and display while internally these values are converted and manipulated in native binary. Hexadecimal numbers are often used by programmers as an intermediate level between binary and decimal notations.

Base	Name	Format (MS <----> LS)
2	Binary	1011 1001
10	Decimal	185
16	Hexadecimal	0xB9 or B9 ₁₆

Multi-Byte Word Formats

Unless otherwise specified numbers or registers spanning multiple bytes are stored in “little endian” format. The first address (ADDR+0) will contain the Least Significant Byte (LSB) while the Most Significant Byte (MSB) will reside at the highest address.

ADDR+0	ADDR	ADDR+n
LSB	LS <----> MS	MSB

INTRODUCTION

The RELAYIO-104 features eight independent “dry-contact” relay outputs and eight independent optically isolated AC/DC digital inputs. It physically conforms to the PC/104 (IEEE P996) standard, uses a single 40-pin IDC type header for all external I/O connections and operates on a single +5Vdc power source. The printed circuitry and I/O circuitry has been carefully engineered to provide a maximum 500V isolation between the PC/104 bus and externally connected devices.



CAUTION: *The 500v isolation specification applies only to input-to-board or board-to-output potential and not the potential between individual I/O channels even though all I/O channels are isolated from each other. The maximum inter-channel potential is limited to 100V.*

The eight relay outputs are SPDT (Form-C) “dry-contact” closures, each providing three independent connections; COMMON, NORMALLY OPEN and NORMALLY CLOSED. All relays are de-energized (Normally Closed) during power off and system reset.

Each digital input can accept either AC or DC voltages in the range of 3V to 24V. In addition, the channels have input filters which can be individually enabled to allow AC frequencies as low as 40hz to be sensed reliably.

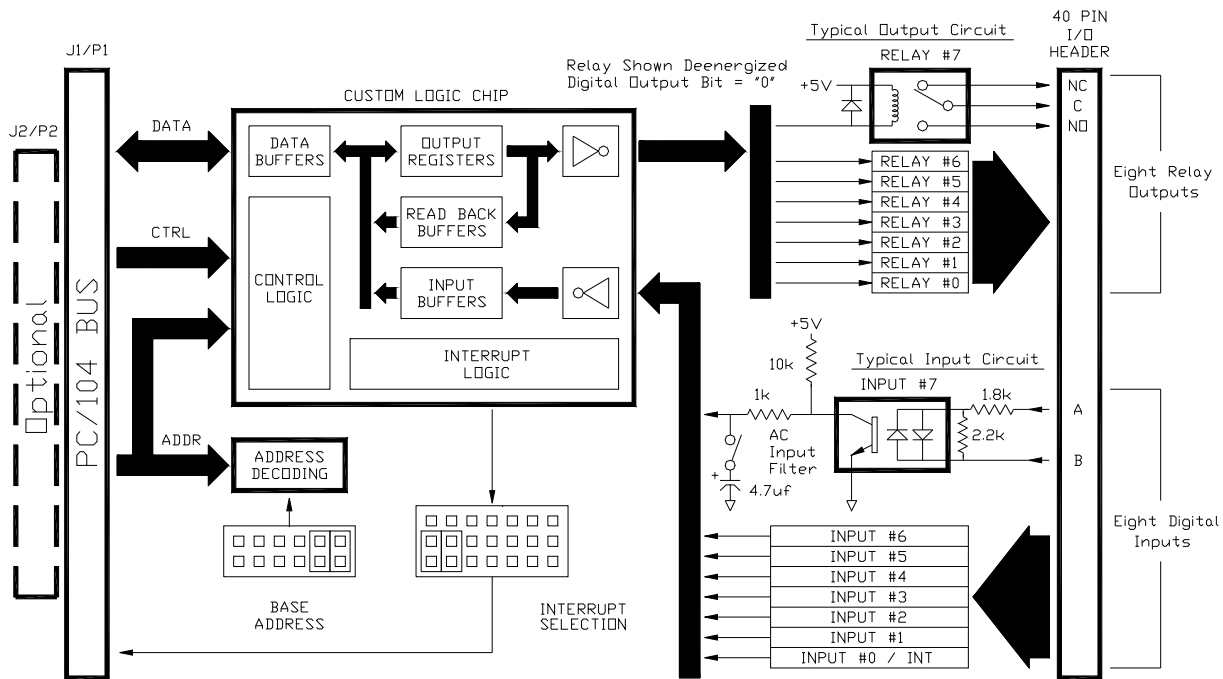


Figure 1 – RELAYIO-104 Simplified Block Diagram

Component Identification

Before the RELAYIO-104 can be put into service it must be properly configured for the desired operating modes. This is accomplished by placing shorting jumpers and by setting switches located at various positions on the module. The component identification is shown in Figure 2. Each RELAYIO-104 comes from the factory set to a basic functional default configuration. The user is free to change the default settings to satisfy any particular application requirements. A full explanation for each setting appears in subsequent sections of this manual.

RELAYIO-104 Component Identification	
Item	Description
1	Interrupt Configuration Jumpers (J8) This jumper block enables and sets which interrupt request line will be associated with the RELAYIO-104. The optional J2/P2 connector (Item 6) must be installed if upper interrupt request lines (IRQ10, 11, 12, 14 or 15) will be used.
2	Base Address Jumpers (J7) This jumper block determines the base address where the RELAYIO-104 will reside in the host's I/O map.
3	AC Input Filter Switches These eight switches correspond to the eight digital inputs. A switch in the "ON" or "CLOSED" position activates a low-pass filter for the respective digital input and enables reliable AC signal monitoring. Note: Switch #1 corresponds to digital input #0 and so on.
4	I/O Connector (J6) This 40-pin IDC header is used to connect the RELAYIO-104 to external devices.
5	PC/104 J1/P1 Connector This connector is the 8-bit PC/104 bus.
6	Optional PC/104 J2/P2 Connector An optional 20-pin connector (J2/P2) can be installed to upgrade the RELAYIO-104 for 16 bit stack-through compatibility and to gain access to upper interrupt request lines.

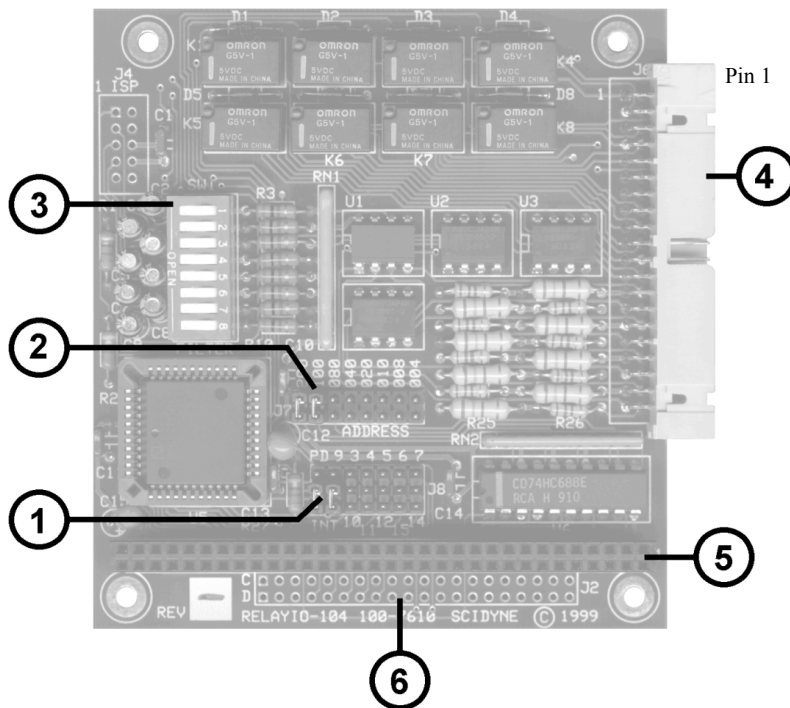


Figure 2 - RELAYIO-104 Component Identification

MODULE BASE ADDRESS AND REGISTER MAP

Setting the Module Base Address

The RELAYIO-104 occupies 4 consecutive I/O bytes and can be placed on any 4 byte boundary within the host's I/O map. The factory default I/O address is 0x300 (768₁₀) but is easily changed to accommodate any special requirements. The eight position jumper block, J7, determines the base address. Each jumper position corresponds to a "weighted" I/O address as shown in the following table. The module's starting I/O address is calculated by simply adding together the "weight" for each jumper that is installed.

NOTE: *Addresses between 0x000 through 0x0ff are generally used by the host and should be avoided. Make sure the I/O address selected will not conflict with any existing I/O hardware.*

Example: The factory default address is set by placing jumpers at positions 0x100 and 0x200.

Installed jumper		Address Value "weight"			
J7-2		0x100		(256)	
J7-1	+	0x200	+	(512)	

		0x300 ₁₆	=	768 ₁₀	= BASE ADDRESS

J7 Base Address Jumper Settings								
J7	-1	-2	-3	-4	-5	-6	-7	-8
Weight (Dec)	0x200 (512)	0x100 (256)	0x080 (128)	0x040 (64)	0x020 (32)	0x010 (16)	0x008 (8)	0x004 (4)

Shaded area represents J7 factory default installed jumper positions. All other positions are left open. The values printed on the circuit board are in hexadecimal notation.

Register Map

The various RELAYIO-104 peripheral functions are accessed at specific offsets relative to the base address. Some locations are write-only, read-only or may be both written and read. Performing a read operation from a write-only location will return an indeterminate value. Writing to a read-only location will not cause a fault but should be avoided for reasons of future compatibility.

RELAYIO-104 I/O Register Summary										
Byte Offset (Dec)	Name	R/W	Host Data Bus							
			D7	D6	D5	D4	D3	D2	D1	D0
0	DOUT_REG	R/W	OUT7	OUT6	OUT5	OUT4	OUT3	OUT2	OUT1	OUT0
1	DIN_REG	R	IN7	IN6	IN5	IN4	IN3	IN2	IN1	IN0 / INT
2	INT_STAT	R	0	0	0	0	0	0	0	IS
		W	X	X	X	X	X	X	X	X
3	Reserved	NA	X	X	X	X	X	X	X	X

X = Not used, Not implemented, Undefined or Don't care

HARDWARE/SOFTWARE DETAILS

General

External devices attach to the RELAYIO-104 through J6, a 40-pin IDC type connector. The pinout for J6 is shown in the following table.

⚠ WARNING: *Observe proper precautions when connecting to J6. Always remove power to the PC/104 computer and all external devices before connecting or de-connecting any attachments to J6. Before re-applying power, verify that all connections made to J6 are oriented correctly.*

📝 NOTE: *The J6 PIN #1 designation is printed on the circuit board and may also be identified by a small triangle molded into the connector's plastic shroud.*

J6, Input/Output Header Connections			
Pin	Description	Pin	Description
1 ▼	OUT7 COM	2	OUT7 NO
3	OUT7 NC	4	OUT6 NO
5	OUT6 NC	6	OUT6 COM
7	OUT5 COM	8	OUT5 NO
9	OUT5 NC	10	OUT4 NO
11	OUT4 NC	12	OUT4 COM
13	OUT3 COM	14	OUT3 NO
15	OUT3 NC	16	OUT2 NO
17	OUT2 NC	18	OUT2 COM
19	OUT1 COM	20	OUT1 NO
21	OUT1 NC	22	OUT0 NO
23	OUT0 NC	24	OUT0 COM
25	IN7 A	26	IN7 B
27	IN6 A	28	IN6 B
29	IN5 A	30	IN5 B
31	IN4 A	32	IN4 B
33	IN3 A	34	IN3 B
35	IN2 A	36	IN2 B
37	IN1 A	38	IN1 B
39	IN0/INT A	40	IN0/INT B

NC = Normally Closed
 NO = Normally Open
 COM = Common
 OUT = Relay Output
 IN = Digital Input
 INT = Interrupt Input (Positive Edge Triggered)

Relay Outputs

The RELAYIO-104 has eight independent sealed SPDT (form C) relay outputs. To ease wiring constraints and permit flexible mixing of AC and DC signals, the Normally-Closed (NC), Normally-Open (NO) and Common (COM) contacts from each relay are available separately on connector J6. The relays are capable of handling loads up to 1A @ 24Vdc or 0.5A @ 125V_{RMS}. Break-Before-Make operation assures the Normally-Closed and Normally-Open contacts will never be mechanically connected to each other or to the relays COM contact at the same time.



CAUTION: Inductive loads often generate voltages with enough potential to cause arcing between a relay's contacts. This effect can cause problems in some situations and inevitably reduces the life-time of the contacts. When driving inductive loads it is suggested that an appropriate "Snubber" network be used across the contacts to dissipate any inductive spikes that may occur.

DOUT_REG

The relay outputs are controlled by the 8-bit register **DOUT_REG**. Each bit of this register corresponds to one of the eight relay outputs as shown. Writing a bit as "0" causes the corresponding relay to turn off (COM connected to NC) while writing a "1" activates the relay (COM connects to NO). This register is both readable and writable allowing read-modify-write bit manipulation software techniques to be used. The **DOUT_REG** is automatically cleared to all zeros during a system reset.

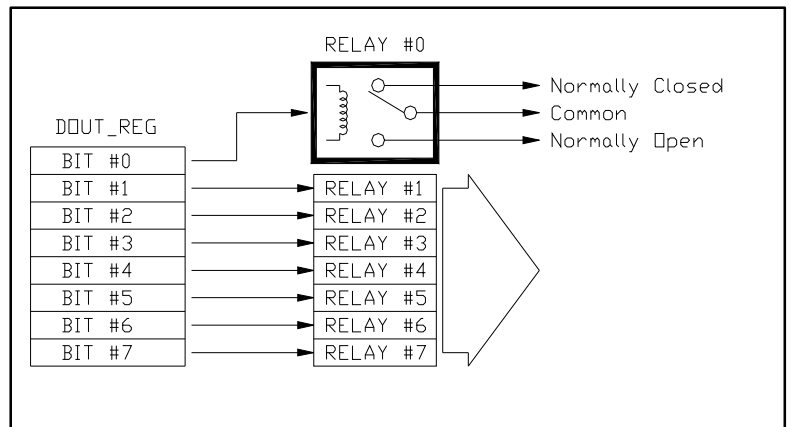


Figure 3 - DOUT_REG Functional Diagram

DOUT_REG: Digital Output Register							0x00
Bit 7	6	5	4	3	2	1	Bit 0
R/W	R/W	R/W	R/W	R/W	R/W	R/W	R/W
OUT7	OUT6	OUT5	OUT4	OUT3	OUT2	OUT1	OUT0
Reset:	0	0	0	0	0	0	0

OUT[7:0] Output control bits


These bits control and report the status of the relay outputs.

Bit = 0: Relay de-activated, COM and NC contacts connected

Bit = 1: Relay activated, COM and NO contacts connected

Digital Inputs

The RELAYIO-104 has eight digital inputs. Each input uses a separate non-polarized optical coupler to provide electrical isolation between the host and the external AC/DC driving signal as well as isolation between the individual I/O channels. Some devices such as PLCs (Programmable-Logic-Controllers) do not separate each of their outputs from each other. In these situations the RELAYIO-104's "A" signal inputs are often ganged together and connected to a power source at the PLC. The input-to-board isolation is still preserved but the digital inputs are now referenced to each other and share the same potential. This configuration can simplify and reduce wiring over long distances. An input is activated by pulling the corresponding "B" input to common, typically by means of an open-collector transistor output generated by the PLC.

 NOTE: A digital input can not be activated by simply connecting its associated "A" and "B" terminals together; i.e.: by means of a simple contact closure. The input circuitry requires an external power source with sufficient voltage and current to illuminate the input LED. However, this requirement is commonly met inherently by the controlling peripheral.

DIN_REG

The status of the digital inputs is stored in a register called DIN_REG. The eight bits correspond to the eight digital inputs. When an input is energized the corresponding bit will be logic "1". Likewise, a de-energized input will appear as logic "0".

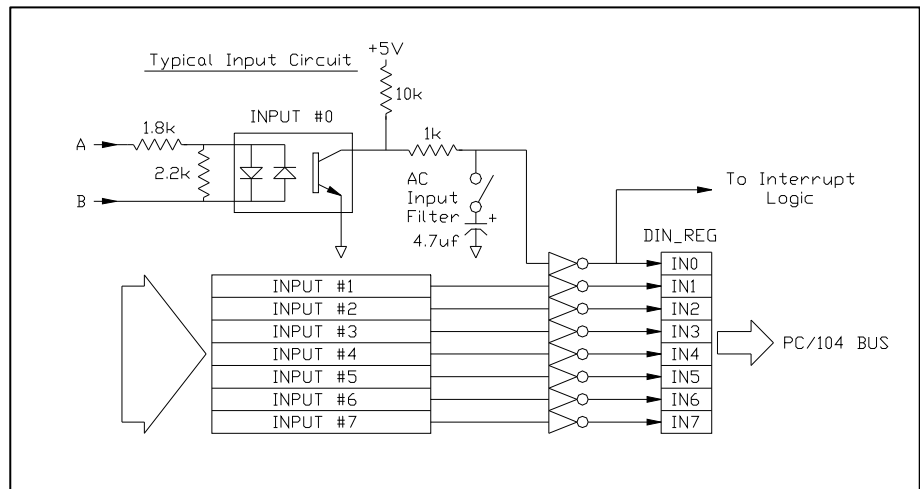


Figure 4 – DIN_REG Simplified Block Diagram

DOUT_REG: Digital Input Register

0x01

Bit 7	6	5	4	3	2	1	Bit 0
R	R	R	R	R	R	R	R
IN7	IN6	IN5	IN4	IN3	IN2	IN1	IN0/INT

Reset: X X X X X X X X

IN[7:0] Input status bits


These bits control and report the status of the digital inputs.

Bit = 0: Input de-activated

Bit = 1: Input activated

AC Input Filters

The optical isolators used in the digital input circuitry are designed to accept AC signals. However, the corresponding bits in the **DIN_REG** will momentarily switch between logic “1”, “0” and back to “1” as the input signal crosses through 0V while changing polarity. Depending on when the host application reads the **DIN_REG** the bits can be misinterpreted even though a steady state AC signal is applied. To overcome this condition the RELAYIO-104 is equipped with a low-pass filter on each of the inputs. DIP switch SW1 is used to selectively enable the filter for each input. A switch in the “ON” or “CLOSED” position enables the filter for that particular digital input. The filters do not affect the input impedance of the digital inputs.

 NOTE: *Inputs which are controlled by DC signals may also benefit by using the AC filters. If the input is being driven over a long distance or if the DC signal is excessively noisy enabling the filter can help minimize erroneous readings.*


SW1 AC Input Filter Selection	
SW1 Position	Digital Input
-1	IN0 / INT
-2	IN1
-3	IN2
-4	IN3
-5	IN4
-6	IN5
-7	IN6
-8	IN7

HOST INTERRUPT

The RELAYIO-104 provides the capability to optionally generate a host interrupt when digital input #0 becomes activated. This feature is particularly useful for counting external pulses or when applications must provide immediate attention to important external events.

Host Interrupt Configuration

Jumper block J8 configures which host interrupt will be associated with the RELAYIO-104. Any interrupt may be used but the optional J2/P2 connector is required to access the upper interrupt request channels (IRQ10, 11, 12, 14 or 15). An interrupt is selected by placing a shorting jumper between the center row of J8 and the corresponding interrupt pin. Interrupt capability is disabled by placing a shorting jumper at the DIS position of J8 (factory default). The interrupt driver on the RELAYIO-104 conforms to the method for interrupt sharing as outlined in the PC/104 specification. This method recommends that one of the PC/104 modules sharing an IRQ provide a passive pull-down resistor to ground. The RELAYIO-104 can supply the pull-down resistor when a shorting jumper is installed at the PD position of J8. The pull-down resistor has no effect when interrupts are disabled.

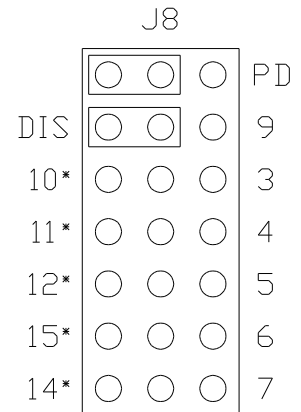

* Requires optional J2/P2 Connector

Figure 5 - J8

NOTE: Try selecting an interrupt which is not currently being used by other system resources. Certain interrupts have a defacto standard usage and should be avoided. If interrupts must be shared make sure all the software applications involved support interrupt sharing. To prevent excessive current draw and the possibility of erroneous operation, use only one pull-down per IRQ. Interrupt #9 is re-directed to IRQ2 on most AT style computers.

Interrupt Status Register

The INT_STAT (Interrupt Status) register is used to monitor and determine if interrupt requests are being generated by the RELAYIO-104. It is also used to remove an interrupt request after it has been recognized and serviced. Applications which do not need full interrupt capability can simply poll the INT_STAT register to see if digital input #0 has become or was previously activated.

INT_STAT: Interrupt Status Register								0x02
Bit 7	6	5	4	3	2	1	Bit 0	
R/W	R/W	R/W	R/W	R/W	R/W	R/W	R/W	
0	0	0	0	0	0	0	IS	
Reset:	0	0	0	0	0	0	0	


Bit 7-1 Not used. These bits will always read as logic "0".

IS Interrupt Status

This bit is set whenever digital input #0 changes from a de-activated to an activated state. The event is latched keeping the bit set even if digital input #0 is activated for only a short time. Jumper block J8 must be properly configured for the interrupt request to be passed up to the host. The entire INT_STAT register is cleared by writing any byte value to it. It is automatically cleared during system reset.

Interrupt Circuitry and Timing Sequence

The interrupt circuitry functional diagram and timing sequence are shown below. Whenever sufficient voltage and current are applied to digital input #0 it changes from a de-activated to an activated state forcing the output of the opto-isolator to switch to logic “0”. This signal is routed to the inverter (via the optional AC filter) which then outputs a logic “1” and clocks the flip-flop on the rising edge. This in turn causes its “Q” output to become logic “1”. The state is echoed in the **IS** bit in the Interrupt Status Register and simultaneously enables the tri-state interrupt driver. If the input signal is actually a momentary pulse the event is stored by virtue of the flip-flop. If interrupts are properly configured the driver then sends an interrupt request to the host as determined by the J8 jumper settings. The request invokes an interrupt service routine on the host. If interrupts are shared, the host can first examine the **IS** bit to determine if the RELAYIO-104 is causing the request. The **INT_STAT** register must be written to during the interrupt service routine to reset the flip-flop which clears the **IS** bit and releases the interrupt request.

 **NOTE:** Digital input #0 is **NOT** Schmitt triggered. When using it for interrupts the driving signal should have clean sharp edges to prevent spurious or multiple interrupts requests.

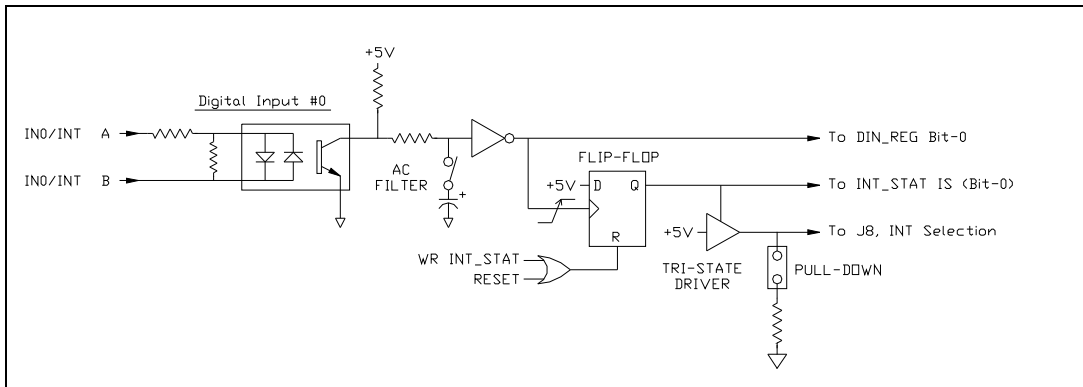


Figure 6 – Interrupt Circuitry Block Diagram

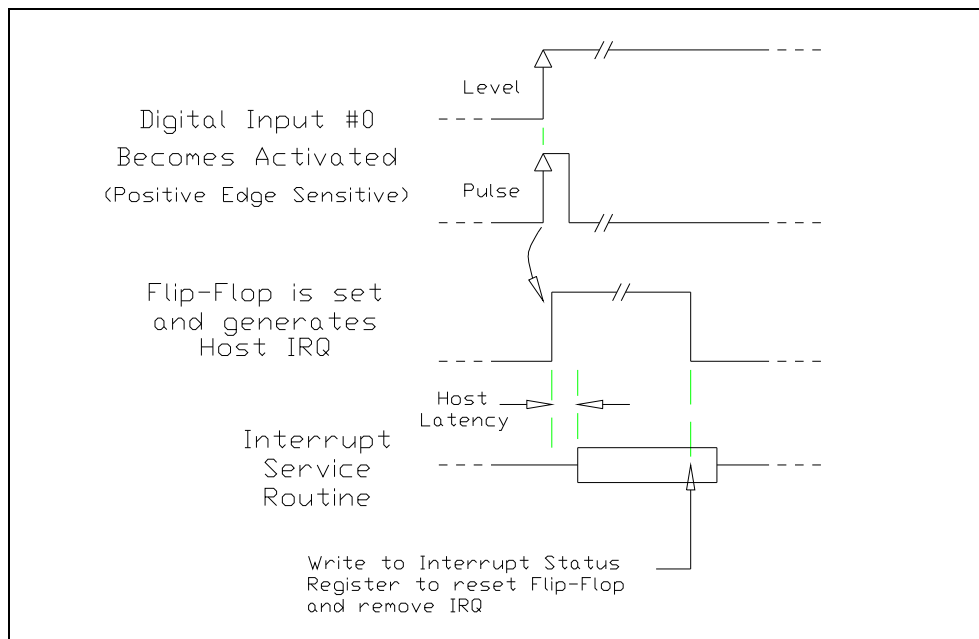


Figure 7 – Interrupt Timing Sequence

SPECIFICATIONS

General:

I/O connections: 40 Position IDC type header
Isolation (All I/O): 500V DC or AC, input-to-board or board-to-output. Isolation between I/O signals: 100V maximum
Power requirement: +5Vdc $\pm 5\%$ @ 80mA typical. Additional 30ma required for each activated relay
Dimensions: PC/104 compliant (IEEE 996), 3.55"W x 3.775"L. 8-bit stack-through, optional 16-bit stack-through
Environmental: Operating temperature: -20°C to 70°C Non-condensing relative humidity: 5% to 95%
Addressing: 8-bit PC/104 bus. Occupies any consecutive 4-byte block in host's I/O map, $0x000_{16}$ through $0x3fc_{16}$

Relay Outputs:

General: Eight SPDT (Form C) sealed electro-mechanical relays, Break-Before-Make operation
Power handling:
 DC: 1 Ampere @ 30Vdc maximum
 AC: 0.5 Ampere @ $125V_{\text{RMS}}$ maximum (resistive load)
Switching capacity: 1ma, 5Vdc minimum, 62.50 VA, 30W maximum
Contact resistance: 100m Ω maximum, Ag (Au clad) contacts
Operate time: 5ms maximum (activate or release)
Service life: 5×10^6 operations minimum

Digital Inputs:

General: Eight independent non-polarized optically isolated inputs
Input voltages:
 DC: 3V minimum, 24V maximum, non-polarized
 AC: $3V_{\text{PP}}$ minimum, $24V_{\text{PP}}$ maximum, 40hz to 1khz
Switching time: Typical @ 5V, Filter Disabled: On: 40 Φ s Off: 100 Φ s Filter Enabled: On: 20ms Off: 85ms
Input impedance: 1.8k Ω minimum
AC input filter: RC type low-pass. Selectable on a per input basis

Interrupt:

One interrupt, Jumper selectable IRQ 3, 4, 5, 6, 7, 9, (10, 11, 12, 14, 15)* or Disable. Fully supports sharing. Associated with digital input #0 activation, positive edge sensitive.
* Optional J2/P2 connector required if upper interrupts will be used.